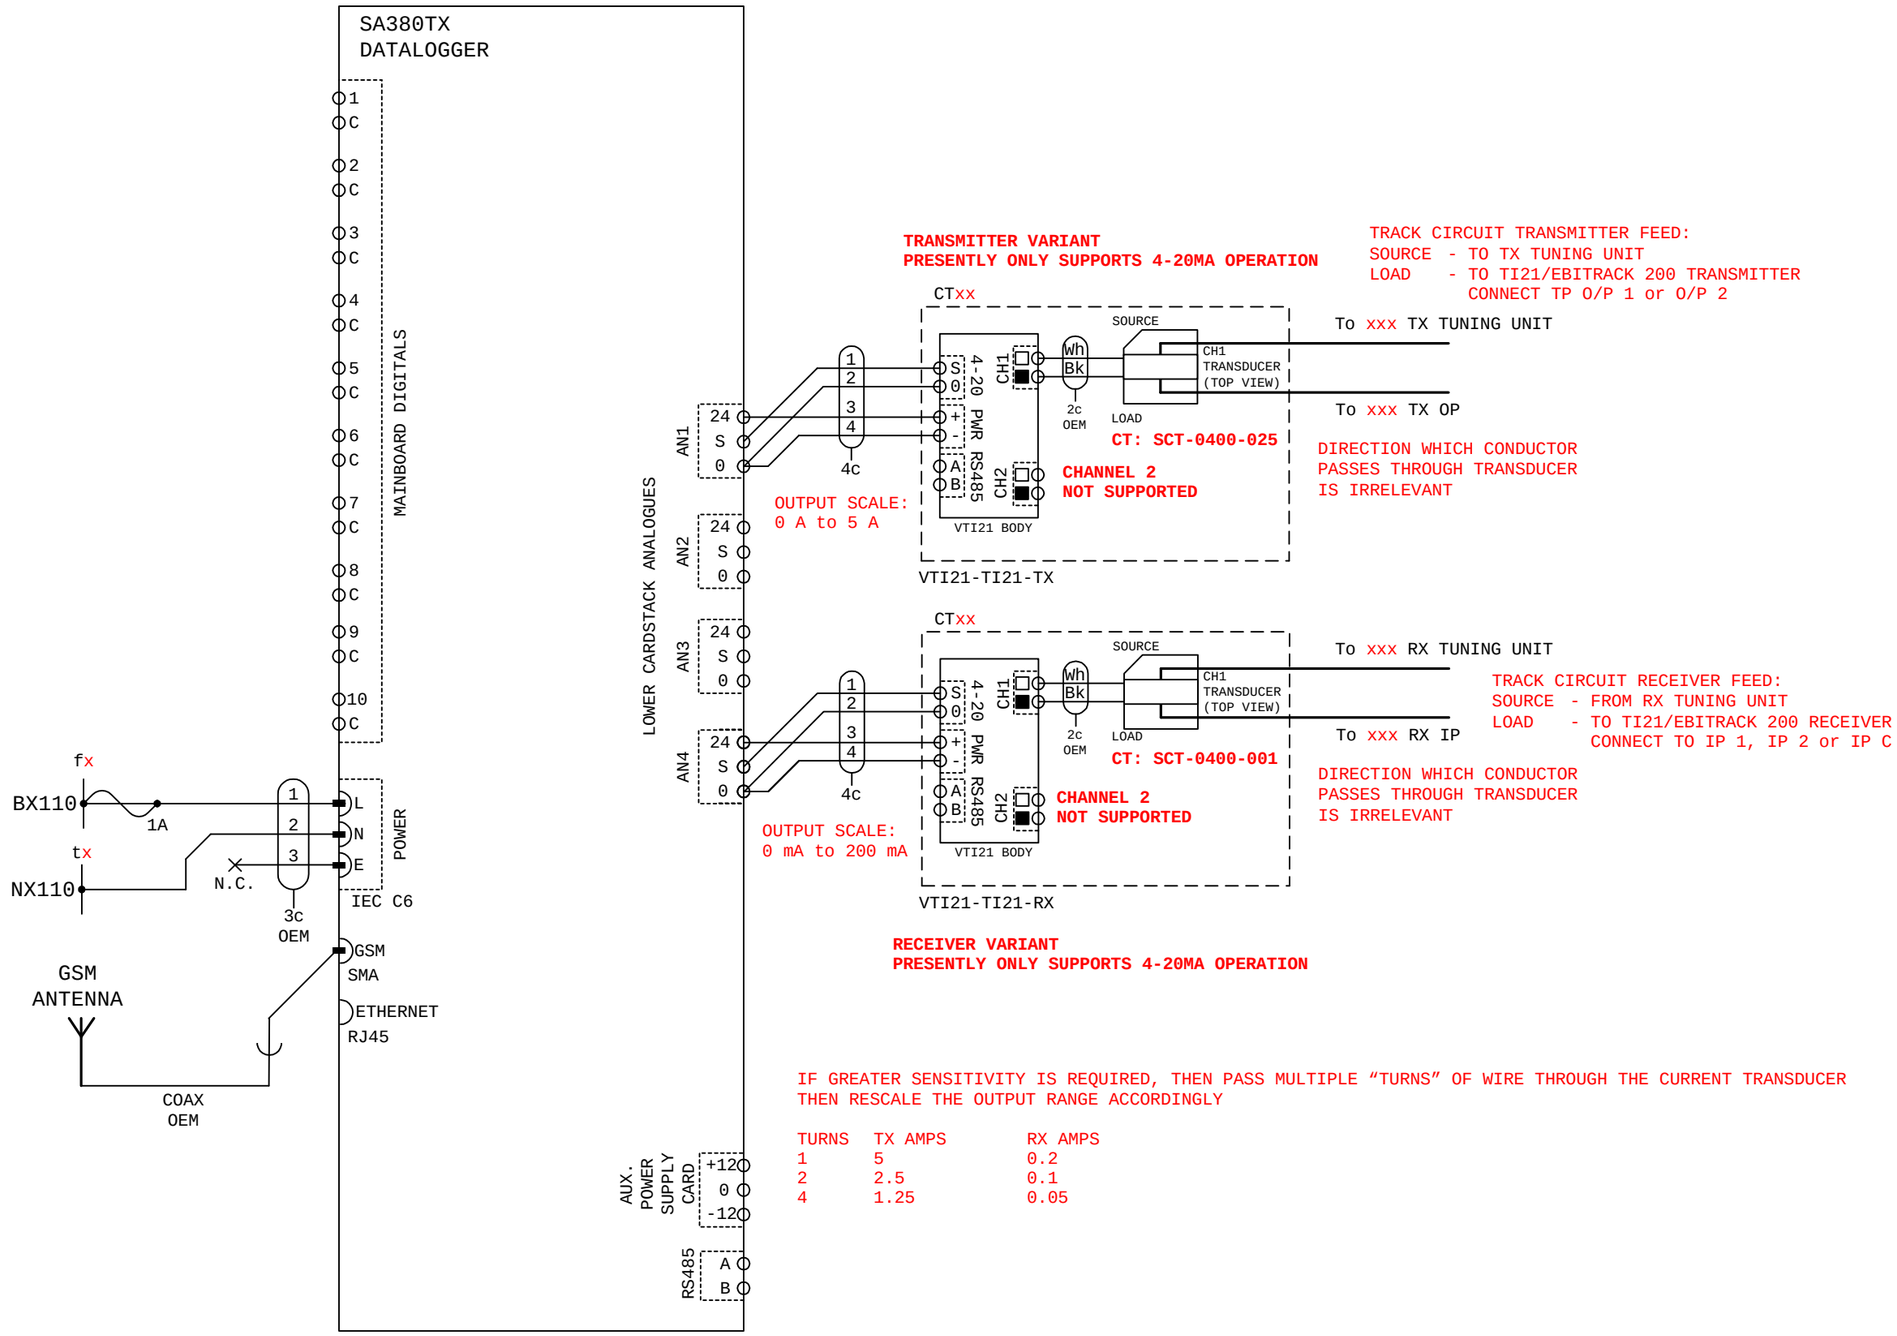

IF GREATER SENSITIVITY IS REQUIRED, THEN PASS MULTIPLE “TURNS” OF WIRE THROUGH THE CURRENT TRANSDUCER THEN RESCALE THE OUTPUT RANGE ACCORDINGLY

TURNS	TX AMPS	RX AMPS
1	5	0.2
2	2.5	0.1
4	1.25	0.05

Drawn:	Checked:	Produced by:	Title:	Drawing No:	MPE-VTI-002
MJB	ML	mpec	VTI21-EBI TRACK 200 / TI21 TYPICAL CIRCUIT	Issue No.	AA2
				Issue Date:	24th Aug 2020